Issue: 6.1 June 2019



# NS Putty & NS Putty Pad Technical Data Sheet

UIC of product-type:











FSI Limited Westminster Industrial Esta Tamworth Road Measham DE12 7DS UK www.fsiltd.com Email: technical@fsiltd.com Tel: +44 (0) 1530 515130 Fax: +44 (0) 1530 273564









# Contents

Contents	Page
<ul> <li>Product Technical Data</li> </ul>	1 - 2
- Product Overview	
<ul> <li>Performance Data - Walls</li> </ul>	3 - 4
<ul> <li>- 135mm Rigid and Flexible Walls</li> <li>- 125mm Rigid and Flexible Walls</li> <li>- 120mm Rigid and Flexible Walls</li> <li>- 150mm and 100mm Rigid and Flexible Walls</li> </ul>	
<ul> <li>Performance Data - Floors</li> </ul>	5
- 150mm and 100mm Rigid Floors	

## **Product Technical Data**

#### **Technical Description of NS Putty**

NS Putty is a solvent free putty for fire barriers up to 240 minutes. It is designed as a joint filler and sealer for use in penetration seals. Tested to EN1366-3 on C1, C2 and D1 Type Cables, Cable Trays and Metallic Pipes.

NS Putty is designed to remain flexible allowing for thermal and mechanical movement of services around complex and irregular shapes through walls or floors.

#### **Technical Description of NS Putty Pads**

NS Putty Pads are pre-cut intumescent pads designed for easy application around single and double electrical socket installations. Tested in accordance with EN1366-3:2009, NS Putty Pads provide up to 2 hours fire resistance.

Acoustic rated to BS EN ISO 10140/3. Tested for air permeability to EN13141-1 Ventilation for buildings.

#### Intended Use

The specific elements of construction that the system NS Putty and NS Putty Pads may be used to provide a penetration seal in, are as follows:

- Fire resistance testing to EN 1366-3 EI 120, and BS 476 pt 20/22 240mins.
- Fire Classification to EN 13501-2.
- Certifire 3rd Party Accreditation CF 515.
- Acoustic Isolation to EN 10140 to 65dB.
- Fire resistance tested in flexible walls, rigid walls and floors.
- Tested in large service openings up to 250 x 150mm.
- Tested with Metallic Pipes, Cables, Cable Bunches, Cable Trays and Cable Ladders.

#### **Key Product Points**

- Causes no known effects to plastic pipes, plastic cables, sheathing or metallic components.
- Contributes to Green Building.
- Non-setting compound.
- Highly flexible and water resistant.
- Halogen free, resists fungi and vermin.
- Maintains a fire and smoke barrier around sockets in flexible wall systems.
- High tack adhesion, pliable and mouldable with excellent self bonding properties.
- Preformed shape to fit most common socket boxes.
- Shelf Life 12 months DOM.









## **Product Technical Data**

Description for NS Putty Pads	Result	Test Standard
Colour	Green	
Activation	250°C	
Density	1.55-1.6 g/cm <sup>3</sup>	ISO 2811-1:2011
Thickness	4mm	
Fire Resistance	Up to 120 minutes	EN 1366-3: 2009
Expected Shelf Life	12 months from DOM	Store in dry conditions unopened

Description for NS Putty	Result	Test Standard
Packaging	1kg Pail & 20kg Pail	
Colour	White, Red, Grey or Brown	
Density	1.55 g/cm <sup>3</sup>	ISO 2811-1:2011
pH Value	8.2	
Solids	82%	
Shore A Hardness	50	
Application temperature	+5°C to +45°C	
Water Resistance	Good when fully cured	
U.V Resistance	Good	
Joint Movement	±10%	
Fire Resistance	EI 120 & 240 mins	EN 1366-3, BS476
Fire Classification	EN 13501-2	
Expected Shelf Life	12 months from DOM	Store in dry conditions unopened

### Installation for NS Putty

Ensure that the aperture and services in question are tested with NS Putty and NS Putty Pads, and the site conditions are within the application specification. An annular space needs to be present around the service to allow sufficient installation depth.

All services and apertures need to be clean and clear of all dust and loose particles. The aperture temperature needs to at 5°C or above at time of installation.

Upon installation make sure that you install the NS Putty to the recommended installation method for the service you are installing around.

Thumb in NS Putty to the surrounding of the service, to make a compact seal around the service with the full depth intended.

#### Installation for NS Putty Pads

Fold the pad to the shape of the box pressing the edges together.

Press home in and around the box, make a small hole to pull the cables through and seal up firmly.

Work in and around the corners to ensure complete coverage of the socket box.

For external application over the socket box press hard against the partition and make sure there is a good tight fit using pressure.

For internal application trim back around the box to suit and make sure that there is a good seal around any cables before fitting the face of the socket.

Can also be installed over the back of the Socket Box.





## **Performance Data - Walls**

### Substrates

The walls shall be a minimum of **100/ 125/ 135mm thick**. Drywalls shall comprise a minimum of 2 layers of 'Type F' Gypsum board on both faces, with minimum 50mm studs. Masonary / Concrete walls shall have a minimum density for concrete or brick of 670 - 780kg/m<sup>3</sup> and for aerated concrete blocks of 600kg/m<sup>3</sup>. All walls shall have at least the same fire resistance as that required for the sealing system.

### Service support requirements

Services should be rigidly supported via steel angles, hangers or channels, not further than 400mm from the surface of the sealing system on both faces unless specified otherwise in the performance data.

## FLEXIBLE AND RIGID WALL

**Electrical Sockets** 

Flexible and Rigid wall constructions with a minimum wall thickness of 135mm.				
Penetration Specification	Integrity	Insulation		
Inside back box to each face.	120	120		
Outside back box to each face.	120	120		
Inside to exposed face back box, outside to unexposed face back box.	120	120		
Outside to exposed face back box, outside to unexposed face back box.	120	120		
Inside baack box to each face (insulation cut away 400mm x 300mm).	120	90		
Inside back box to each face.	120	120		
Outside back box to each face.	90	90		
Inside to exposed face back box, outside to unexposed face back box.	90	90		
Outside to exposed face back box, inside to unexposed face back box.	120	120		
Inside back box to each face (insulation cut away to 300mm x 300mm).	90	90		

## **Electrical Sockets**

Flexible and Rigid wall constructions with a minimum wall thickness of 135mm.				
Penetration Specification	Integrity	Insulation		
Inside back box to each face.	90	90		
Inside back box to each face.	120	120		

## FLEXIBLE AND RIGID WALL

Metallic Conduit, Cables

Flexible and Rigid wall constructions with a minimum wall thickness of 125mm.				
Penetration Specification	Seal Depth	Classification		
Copper Pipe 40mm ø with 0.8mm wall thickness.	200mm wide x 100mm high x 125mm deep	EI 20 C/U E 120 C/U		
Cables C1 and C2.	200mm wide x 100mm high x 125mm deep	EI 20 E 120		



Cables







(۱)



## FLEXIBLE AND RIGID WALL

Flexible and Rigid wall constructions with a minimum wall thickness of 120mm.				
Penetration Specification	Seal Depth	Classification		
Cables D1.	130mm ø x 120mm deep	EI 90 E 90		

## FLEXIBLE AND RIGID WALL

**Electrical Sockets** 

Penetrationg Services			Fire F	Fire Rating	
		Maximum Aperture Size (mm)	Minimum Seal Depth (mm)	Integrity	Insulation
		25 circular	30	240	240
		30 circular	20	120	120
	Standard Cable (11mm) or small bunch of cables	50 circular	60	240	240
Walls		60 circular	40	120	120
waiis		100 circular	60	120	120
	Square trunking	100 square	150	240	240
		125 square	60	120	0
		125 square	80	120	120
Wall thickness	The walls shall be a minimum of 150mm thick for 240 minutes and 100mm thick for 120 minutes. The minimum density for the concrete of the wall is 670 kg/m <sup>3</sup> and for walls made of concrete blocks is 600 kg/m <sup>3</sup>				
Application Technique	Clean all loose materials and foreign matter from the opening. Ensure opening is free from dust and oil. Ensure that services are in place. Pack the NS Putty around the service into the opening to the required depth. The surface of the NS Putty may be installed flush with non-fire exposed face or the fire exposed face of the wall / floor providing the required minimum depth of seal is applied.				
Service Support Requirements	The services must be supported adjacent to the seal on both sides so that the weight of the services is not taken by the seal.				
Maximum Opening Height	125mm x 125mm Maximum 50% of the area of the opening shall be filled with the penetrating services.				











## **Performance Data - Floors**

### Substrates

The floors shall be a minimum of **150mm thick**. Masonary / Concrete floors shall have a minimum density for concrete or brick of 670-780kg/m<sup>3</sup> and for aerated concrete blocks of 600kg/m<sup>3</sup>. All floors shall have at least the same fire rating as that required for the sealing system.

### Service support requirements


Services should be rigidly supported via steel angles, hangers or channels, not further than 400mm from the surface of the sealing system on top face unless specified otherwise in the performance data.


## **RIGID FLOOR**

## **Electrical Sockets**

	Penetrating Services			Fire Rating		
		Maximum Aperture Size (mm)	Minimum Seal Depth (mm)	Integrity	Insulation	
		25 circular	30	240	240	
	Standard Cable (11mm)	30 circular	20	120	120	
	or small bunch of	50 circular	60	240	240	
Floors	cables	60 circular	40	120	120	
FIOOTS		100 circular	60	120	120	
	Square trunking	100 square	150	240	240	
		125 square	60	120	0	
		125 square	80	120	120	
Floor thickness	The floors shall be a minimum of 150mm thick for 240 minutes and 100mm thick for 120 minutes. The minimum density for the concrete of the floor is 670 kg/m <sup>3</sup>					
Application Technique	Clean all loose materials and foreign matter from the opening. Ensure opening is free from dust and oil. Ensure that services are in place. Pack the NS Putty around the service into the opening to the required depth. The surface of the NS Putty may be installed flush with non-fire exposed face or the fire exposed face of the wall / floor providing the required minimum depth of seal is applied.					
Service Support Requirements	The services must be supported adjacent to the seal on both sides so that the weight of the services is not taken by the seal.					
Maximum Opening Height	125mm x 125mm Maximum 50% of the area of the opening shall be filled with the penetrating services.					

## 

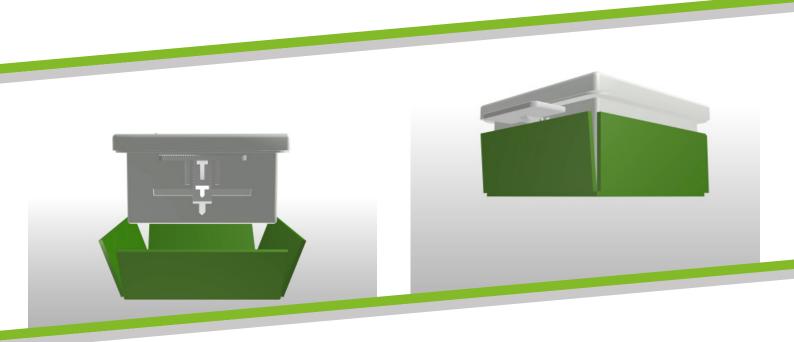

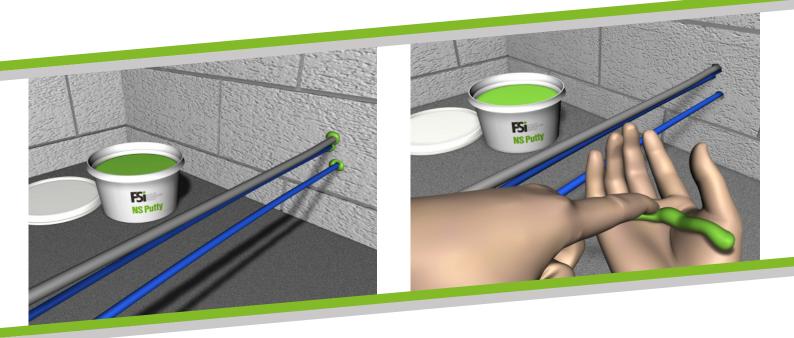

FSi has Technical Representatives who provide assistance in the selection and specification of FSi products. For more information, specification and technical advice please call our Head Office on Tel: +44 (0) 1530 515130. Guarantee / Warranty: FSi products are manufactured to rigid standards of quality. Any product which has been applied in accordance with FSi's written instructions and in any application recommended by FSi, but which is proved to be defective in product quality, will be replaced free of charge. No liability can be accepted for the information provided in this document although it is published in good faith and believed to be correct. FSi Limited reserves the right to alter product specifications without prior notice, in line with our Company policy of continuous development and improvement.